




Fire Lanes

All "Fire Lane" striping is to be done in accordance with the City of Harker Heights Code of Ordinances.


- The stripe shall be six (6) inches wide, painted with a red exterior latex paint designed for traffic use.
- The letters shall be four (4) inches high, with each letter having a ¾ to one (1) inch width or stroke. These shall be painted with a white exterior latex paint designed for traffic use.
- Stripes may be brushed or sprayed, letters shall be stencil formed, brushed or sprayed and spaced as detailed below.
- Striping to be placed on pavement or face of curbs if needed.

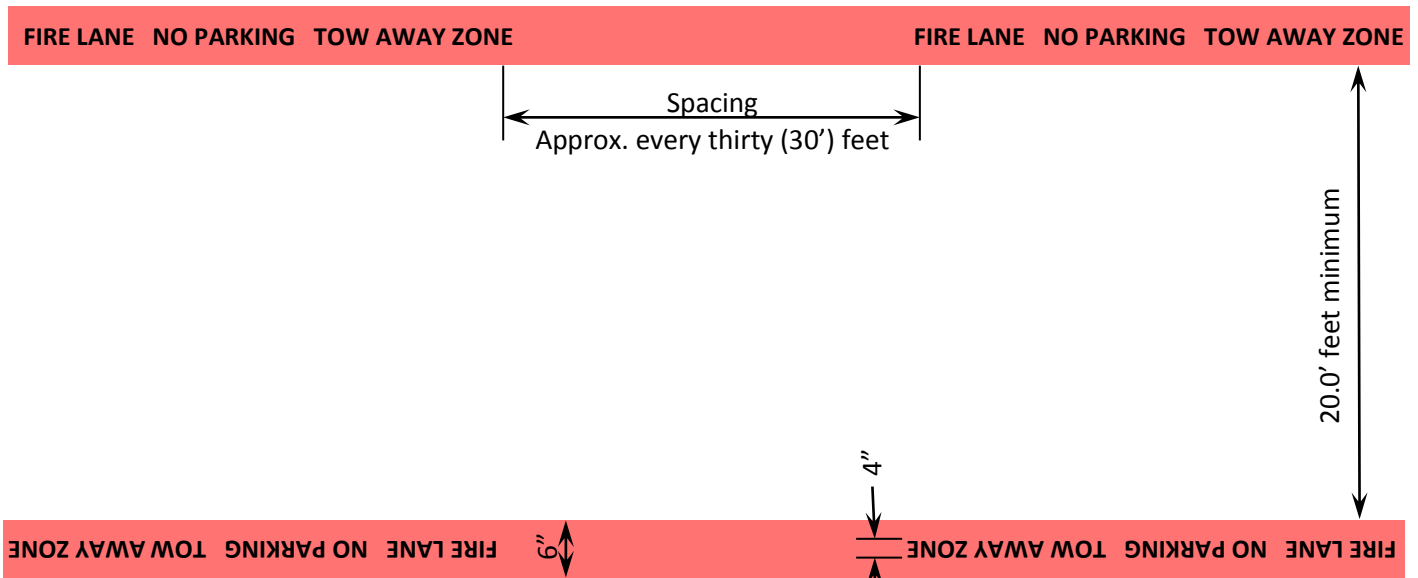

*Fire Lanes installed after January 1, 2016 will be required to have a 24 foot width with corresponding turn radius

W	R	WR
20'	30'	30' Min
26'	20'	30' Min
30'	10	30' Min

W= Width (feet) of Fire Lane
 R= Radius Necessary to Accommodate Fire Vehicles
 WR= Turning Radius Pavement Width

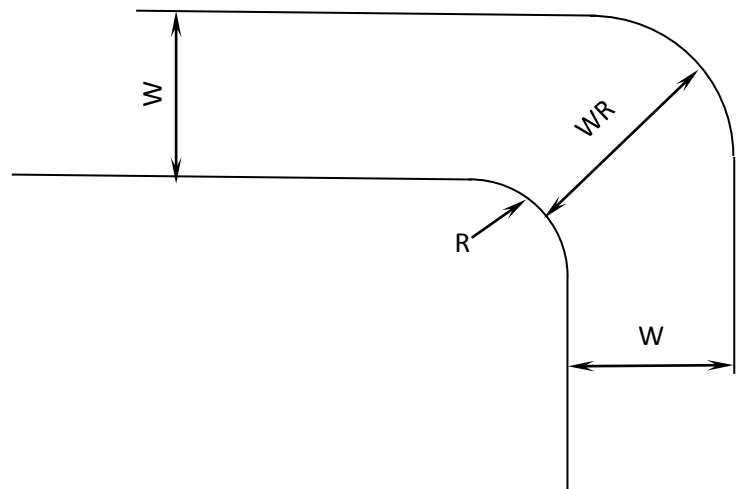

Drawings are not to scale